

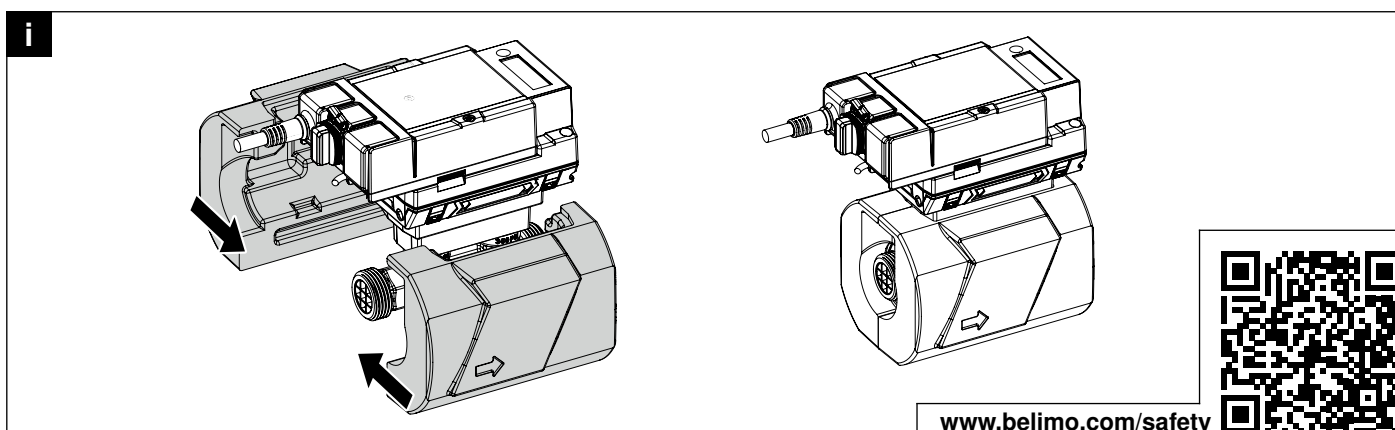
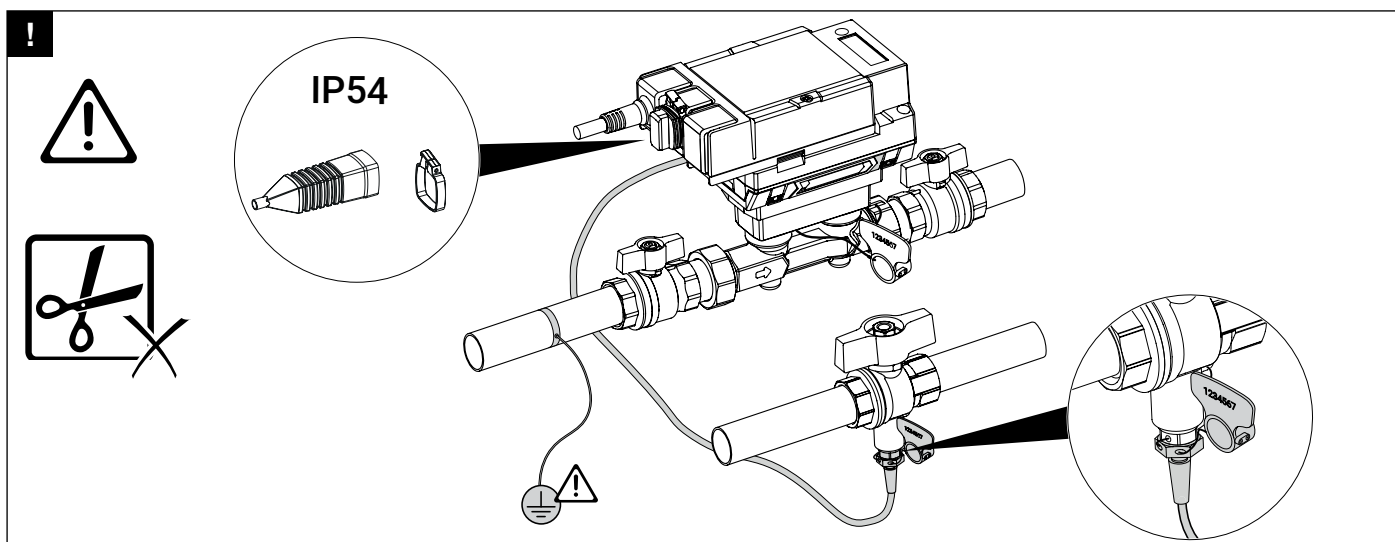
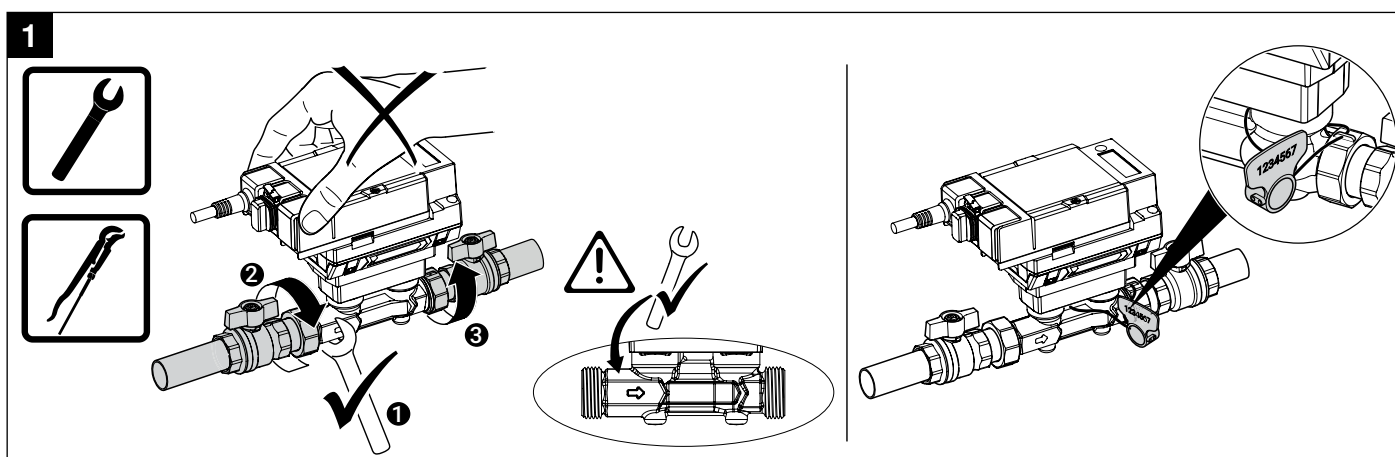
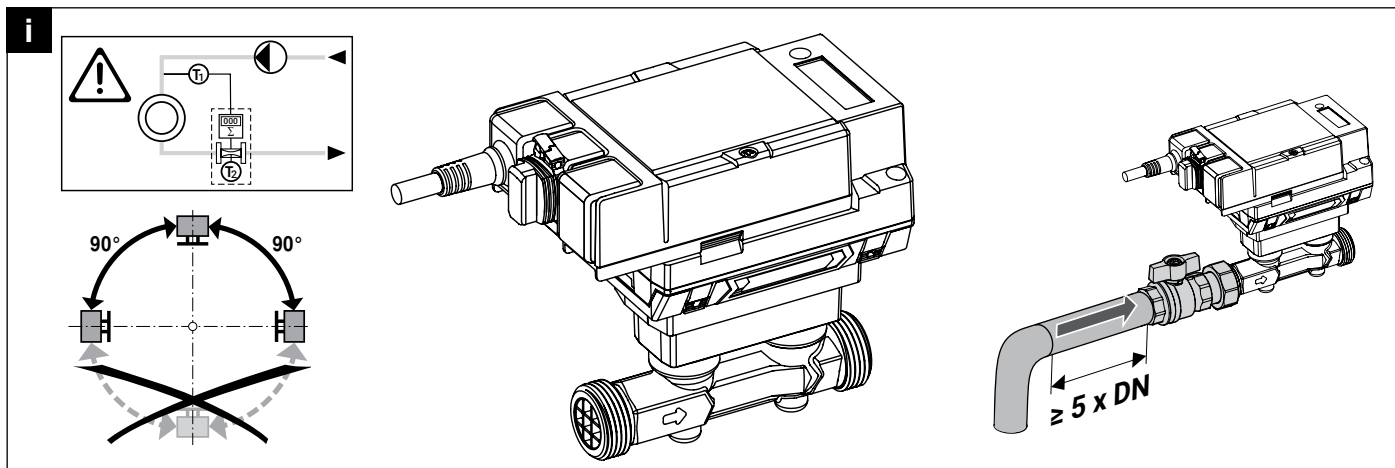
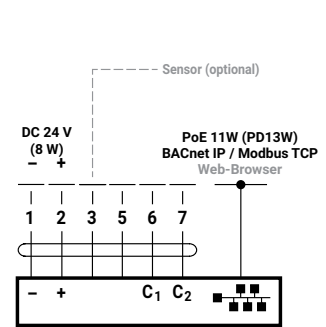


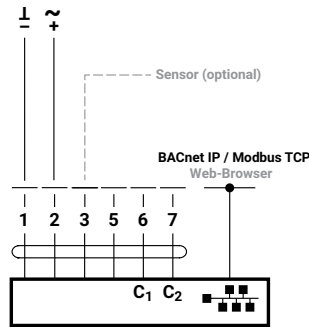


1 = GND
 2 = AC/DC 24 V
 3 = Sensor
 5 = MP, 0...10 V
 6 = C1 = D- = A
 7 = C2 = D+ = B

BACnet IP / Modbus TCP


PoE BACnet IP / Modbus TCP

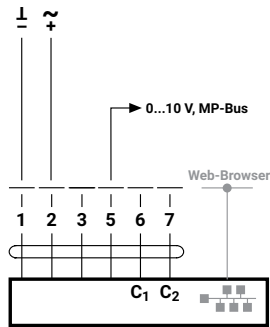

BACnet MSTP / Modbus RTU

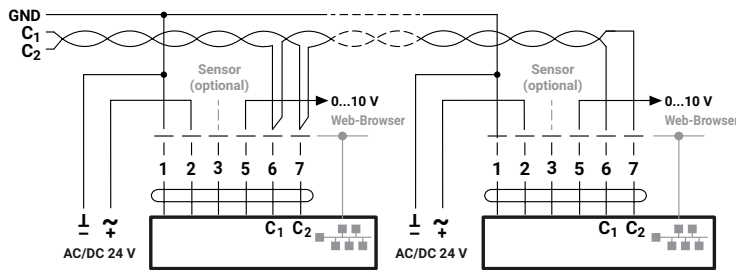

MP-Bus




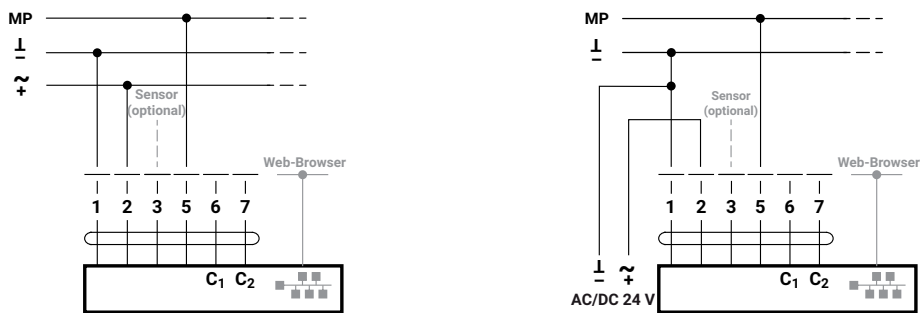


M-Bus

M-Bus / BACnet MSTP / Modbus RTU

M-Bus / BACnet IP / Modbus TCP

M-Bus / PoE / BACnet IP / Modbus TCP

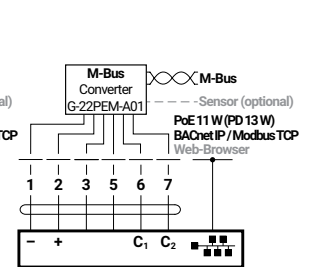

Sensor (optional)

